

# **BLUECALC**<sup>TM</sup>

AIR DISINFECTION ANALYSIS - REPORT

Customer / Project: 10 Ton 24x20 4000cfm

#### **Duct Data**

# Duct Width24 inDuct Height20 inAirflow4000 CFMAir Velocity1200 ft/min

Duct Wall Material Galvanized duct - rough

# **Irradiation Data**

Avg germicidal UV dose delivered	801 μJ/cm2
Air temperature increase	0.0 °C
Exposure time	0.08 s


#### **UVGI Lamp Data**

Model	TUVC-ADS-224D-HO	
Number of Units	1	
Setup type for multiple units	n/a	
Number of Lamps per Unit	2	
Lamp Length	609	mm
UVGI Power per Lamp	19	W
Electrical Power per Lamp	57	W
Electrical Power per Module	114	W
Electrical Power (Total)	114	W
Teflon coating	No	

## Inactivation (sterilization) rates after 18000 hours

Microorganism	Recirculation (6 passes)		
	Minimum	Average	LOG Average
Coronavirus	> 99.99%	> 99.99%	> 4
Tuberculosis	99.77%	> 99.99%	4
Influenza A virus	96.63%	99.67%	2
Adenovirus	79.21%	92.89%	1

### UVC dose inside the duct after 18000 hours (mJ/cm<sup>2</sup>)

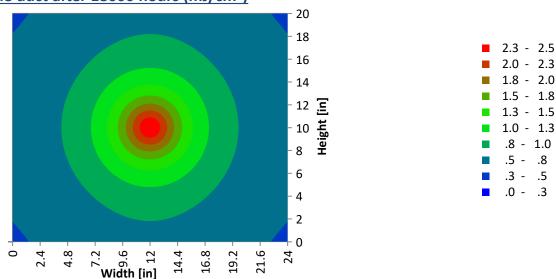

**Note:** 4-log inactivation equals 99.99%. Higher than 4-log inactivation are achieved in real-life scenarios but the exact predictions/model would be inaccurate because the UV disinfection analysis utilises single stage decay data and equations.

**Disclaimer:** The Information and the analysis of this report is proprietary and confidential. Due to the fact that the data used in this analysis is supplied by the end user who takes responsibility for its accuracy, FreshAire UV does not make and expressly disclaims any representations or warranties as to the completeness, accuracy or usefulness of the report. FreshAire UV does not warrant that the use of such information will not infringe any third-party rights, nor does Freshaire UV assume any liability for damages or costs of any kind that may result from use of such information. Data contained in this BlueCalc sizing is subject to change without notice.